



SELECTOR CKT.

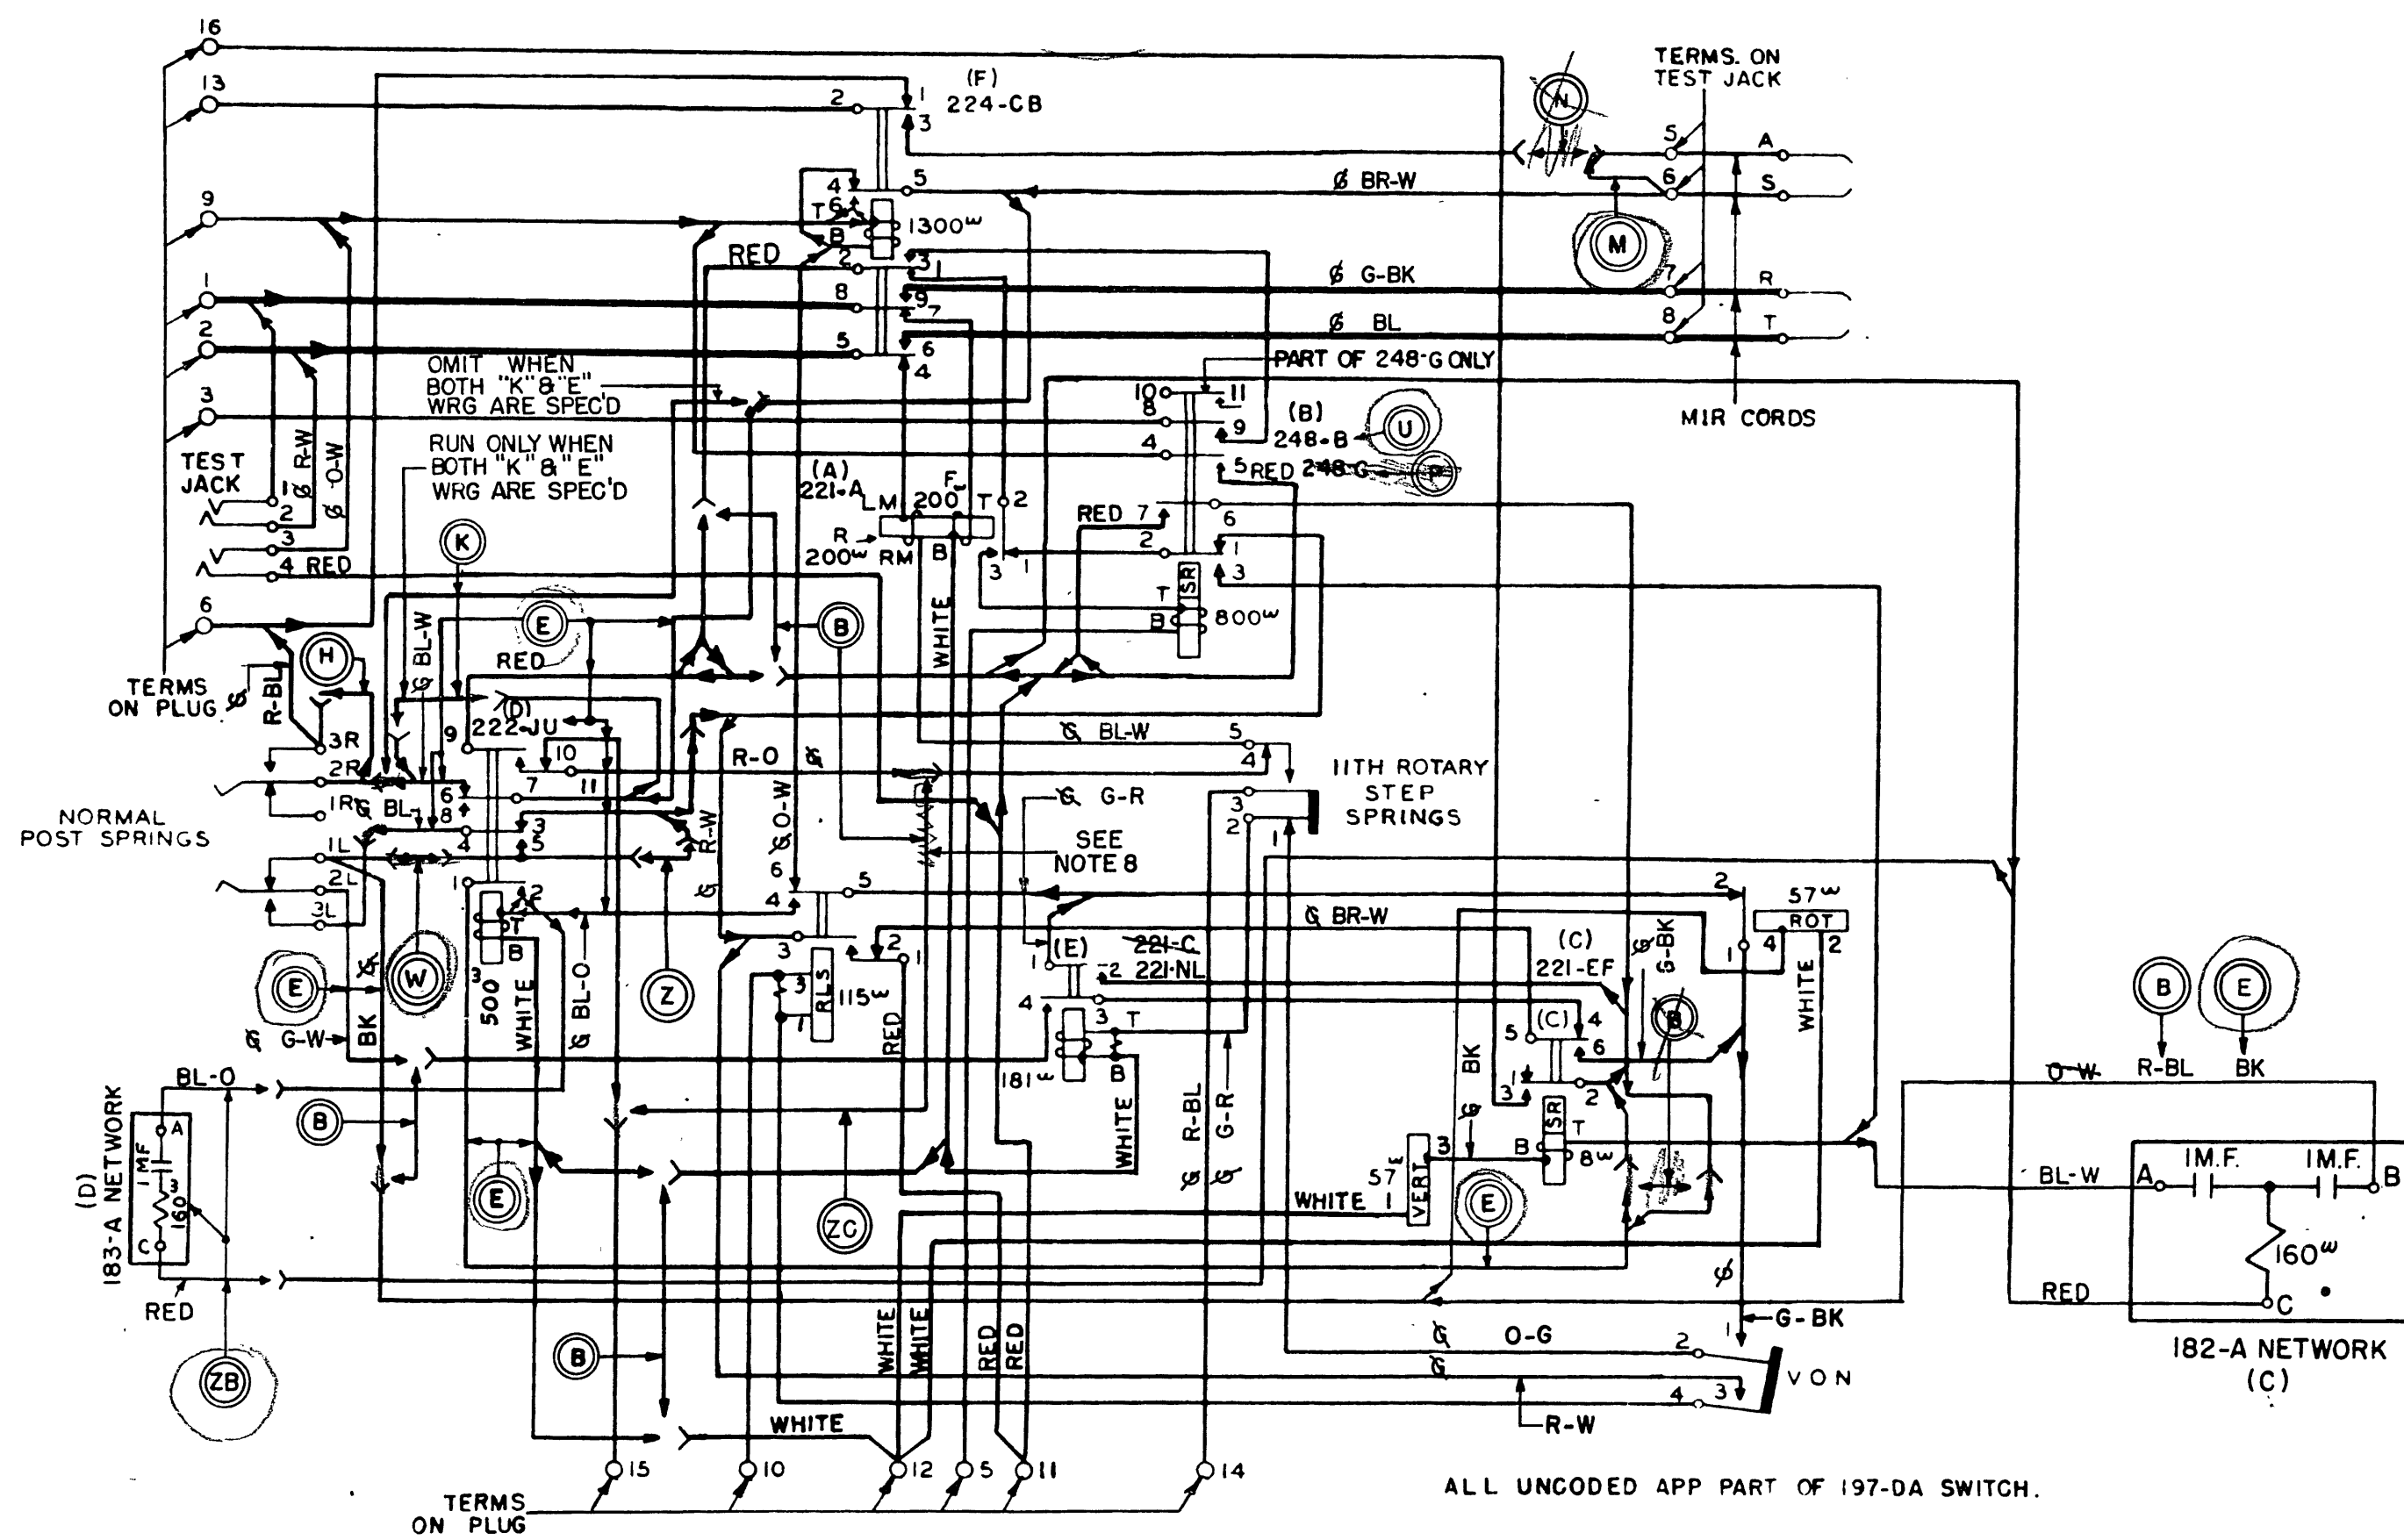


() ITEMS IN PARENTHESES ARE FOR INFORMATION ONLY

[illegible]

SEE BANK & JACK WIRING DWGS FOR ADDITIONAL OPTIONS

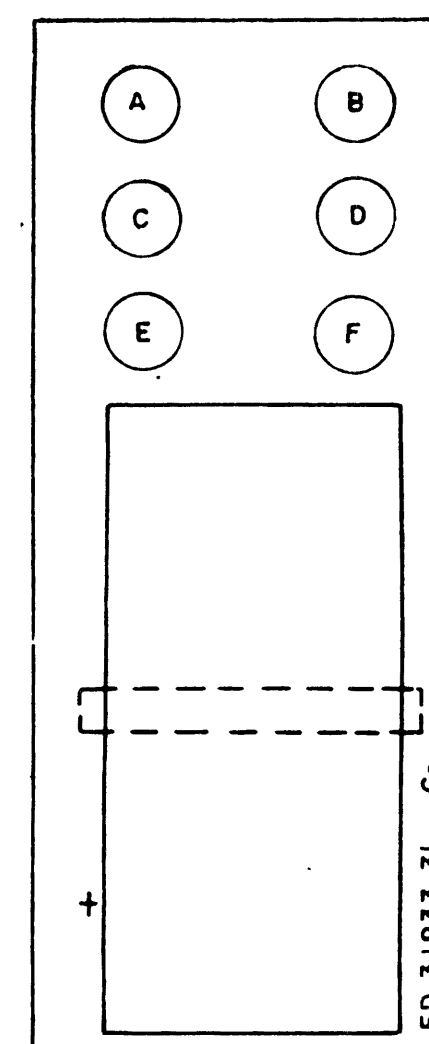

SKETCH A

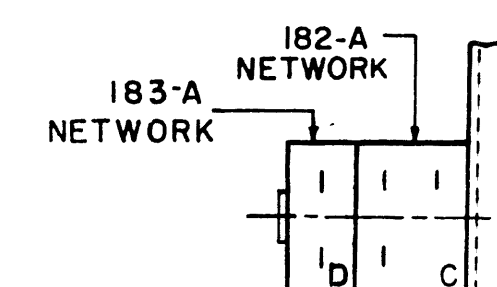

SKETCH B

GRP	QUAN PER GRP	CODE	DESCRIPTION	NOTE
3	1	985D	MTG PLT EQPD WITH SK A	
	1	110A	COVER SK B	
	1	221A	REL POS 1 SK A	
4	1	248B	" " 2	
5	1	248G	" " 2	
	1	221EF	" " 3	
6	1	222JU	" " N	
	1	224C, 22INL	" " 5	
	1	224CB	" " 6	
	1	197DA	SWITCH POS 8, EQPD WITH	
	2	M1R	CORD 4" LG	
	2	M1R	" " 4 3/4" LG	
	1	242B	PLUG POS 9 REAR	
	1	182A	NETWORK SK B	
6	1	183A	" "	

	WH	WRG REQ'D IN ADDITION TO GRP 3 WHEN NO DIAL TONE IS REQ'D.	"ZC" WRG ONLY OF ED-31933-31 FIG.1	
	WG	WRG REQ'D IN ADDITION TO GRP 3 WHEN NO DIGIT ABSORBING IS REQ'D	"B" WRG ONLY OF ED-31933-31 FIG.1	
	WF	WRG REQ'D IN ADDITION TO GRP 3 TO PREVENT CUT-THRU UNTIL A DIGIT HAS BEEN ABSORBED	"H" WRG ONLY OF ED-31933-31 FIG.1	
	WE	WRG REQ'D IN ADDITION TO GRP 3 WHEN SERVICE IS TO BE RESTRICTED ON ANY DIGIT ON SPECIFIED LEVELS (SEE NOTE 54B)	"K" WRG ONLY OF ED-31933-31 FIG.1	
	WD	WRG REQ'D IN ADDITION TO GRP 3 WHEN USED AS A 4 WIRE SELECTOR	"N" WRG ONLY OF ED-31933-31 FIG.1	
	WC	WRG REQ'D IN ADDITION TO GRP 3 WHEN USED AS A 3 WIRE SELECTOR	"M" WRG ONLY OF ED-31933-31 FIG.1	
	WB	WRG REQ'D IN ADDITION TO GRP 3 WHEN ONE DIGIT IS TO BE ABSORBED REPEATEDLY	"Z" WRG ONLY OF ED-31933-31 FIG.1	
	WA	WRG REQ'D IN ADDITION TO GRP 3 WHEN FIRST DIGIT IS TO BE ABSORBED ONCE ONLY	"N" WRG ONLY OF ED-31933-31 FIG.1	
	6	WRG & EQPT REQ'D IN ADDN TO GRP 3 WHEN DIGIT ABS. IS REQ'D. (SEE NOTE 54A)	"E", "B", "ZB" WRG & APP ONLY OF ED-31933-31 FIG.1	
	5	EQPT REQ'D IN ADDITION TO GRP 3 WHEN OFFICE IS ARR FOR CONVERSION TO EXTENDED TRUNKING	"P" APP ONLY OF ED-31933-31 FIG.1	
	4	EQPT REQ'D IN ADDITION TO GRP 3 WHEN OFFICE IS NOT ARR FOR CONVERSION TO EXTENDED TRUNKING	"U" APP ONLY OF ED-31933-31 FIG.1	
	3	ASSEMBLY, EQPT & WRG FOR ONE 3 OR 4 WIRE SEL ARR FOR RESTRICTED SERVICE ON FIRST DIGIT ONLY, LESS ALL OTHER OPTIONS	ED-31933-31 FIG.1	
RATING	GRP	EQUIPMENT	NO	CKT. & FIG. WIRED & EQPT.

TABLE A

ED-31933-31

STEP BY STEP SYSTEMS
NO. 1,350A & 360A OFFICES
3 OR 4 WIRE SELECTOR CIRCUIT
EQUIPMENT AND WIRING
ARRANGED TO ABSORB DIGITS
ONCE OR REPEATEDLY AND TO
RESTRICT SERVICE ON SPECIFIED LEVELS
SURFACE WIRED

(DA SEL)

WESTERN ELECTRIC COMPANY, INC.

ED-31933-31

PRINTED IN U.S.A.

R

ENGINEERING NOTES:

[illegible]

52. CONNECTING DWGS:

52. CONNECTING DRGS:
ASSOC JACK WRG T-532052 & T-532056
BANK WIRING T-616631 (300 PT)
" " T-532055 (400 PT)

53. SPECIFY GROUPS, FIGURES & OPTIONS IN ACCORDANCE WITH

54. SPECIFY THE LEVEL OR LEVELS ON WHICH NORMAL POST SPRINGS ARE TO CLOSE AS FOLLOWS:-

(A) SPECIFY CLOSING OF "LEFT" NORMAL POST SPRINGS ON

(B) SPECIFY CLOSING OF THE "RIGHT" NORMAL POST SPRINGS ON LEVEL OR LEVELS ARRANGED FOR RESTRICTED SERVICE EXCEPT WHEN IT IS DESIRED TO PREVENT CUT THRU UNTIL A DIGIT HAS BEEN ABSORBED (G-WF) IN WHICH CASE "RIGHT" NORMAL POST SPRINGS SHOULD NOT BE ADJUSTED

MANUFACTURING NOTES:

1. WIRES NOT OTHERWISE SPEC'D TO BE 24G
2. WIRES NOT OTHERWISE COLORED TO BE GREEN
3. EQUIP & WIRE CAT PER TABLE "A" IN ACCORDANCE WITH GROUPS SPEC'D
4. THE GROUP NUMBER AT THE TOP OF THE STOCKLIST GRP COLUMN, APPLIES TO ALL ITEMS FOR WHICH GRP DESIGS ARE NOT SHOWN
5. THE GROUP NUMBERS OF THE SWITCH ORDERED SHALL BE STAMPED ON THE APPARATUS MTG PLT
6. NORMAL POST SPRINGS SHALL BE ADJUSTED TO MAKE CONTACT ON LEVELS SPEC'D
7. THIS DRAWING SHOWS NO LEADS TO BE RUN BY INSTALLER
8. WHEN GRP'WG & GRP'WH ARE SPEC'D TOGETHER, ONLY ONE LEAD SHALL BE RUN FROM PLUG IS TO TERM 4 OF I1TH RPT SPGS.
9. WHEN LOCAL CABLES ARE USED FOR LEADS PASSING THROUGH THE PLATE, THE ASSOC. LOCAL CABLE DWG IS LC-724-035
G1 R 02 R 02 R 03

2										
1	SELECTOR CIRCUIT	SD-31933-01	ED-31933-31	AS SPECIFIED IN	TABLE "A"					
LINE	NAME	SCHEMATIC	ISS	DWG NO	ISS	FIG	OPT. WIRING	WIRED	NOTES	REMARKS
CIRCUITS										
SURFACE WIRING PROVIDED										
=	APP TERM INFORMATION DWG	T-618850								
=	SURFACE WIRING RUNNING LIST	SMED-31933-31					MIR CORDS-DRESSING & ATTACHING		ED-30279-01	
	NAME	NUMBER	ISS				NAME		NUMBER	IS
DWGS DESIG. # WILL NOT BE READ BY INSTALLER LIST OF ASSOCIATED DRAWINGS										

ED-31933-31